



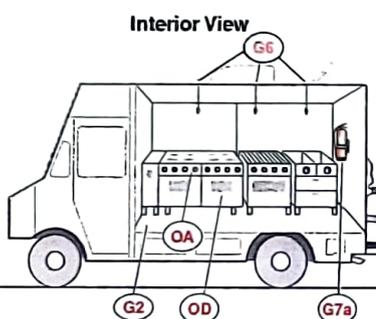


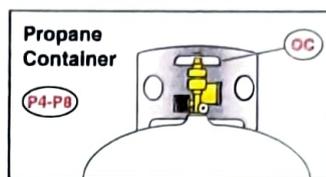

FACT SHEET » Food Truck Safety

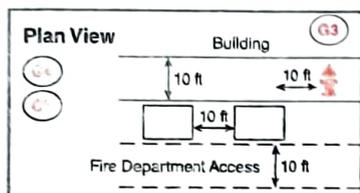

NATIONAL FIRE PROTECTION ASSOCIATION

The leading information and knowledge resource on fire, electrical and related hazards

NOTE: This information is provided to help advance safety of mobile and temporary cooking operations. It is not intended to be a comprehensive list of requirements for mobile and temporary cooking operations. Check with the local jurisdiction for specific requirements. This safety sheet does not represent the official position of the NFPA or its Technical Committees. The NFPA disclaims liability for any personal injury, property, or other damages of any nature whatsoever resulting from the use of this information. For more information, go to nfpa.org/foodtrucksafety.

© 2017 National Fire Protection Association

FACT SHEET » Food Truck Safety (continued)

NFPA code references are provided at the end of each item. The red keys correspond to the NFPA food truck safety diagram. For more detailed information, see Annex B in NFPA 96.

GENERAL SAFETY CHECKLIST

- Obtain license or permits from the local authorities. [1:12.8(a)] G1
- Ensure there is no public seating within the mobile food truck. G2
- Check that there is a clearance of at least 10 ft away from buildings, structures, vehicles, and any combustible materials. [96:7.8.2, 96:7.8.3 for carnivals only] G3
- Verify fire department vehicular access is provided for fire lanes and access roads. [1:18.2.4] G4
- Ensure clearance is provided for the fire department to access fire hydrants and access fire department connections. [1:13.1.3, 1:13.1.4, 1:13.1.5] G5
- Check that appliances using combustible media are protected by an approved fire extinguishing system. [96:10.1.2] G6
- Verify portable fire extinguishers have been selected and installed in kitchen cooking areas in accordance with NFPA 10. [96:10.5.3] G7a
- Where solid fuel cooking appliance produce grease-laden vapors, make sure the appliances are protected by listed fire-extinguishing equipment. [96:14.7.1] G7b
- Ensure that workers are trained in the following: [96:8.15.1]: G8
 - Proper use of portable fire extinguishers and extinguishing systems [10:1.2] G8a
 - Proper method of shutting off fuel sources [96:10.4.1] G8b
 - Proper procedure for notifying the local fire department [1:10.14.9 for carnivals only] G8c
 - Proper procedure for how to perform simple leak test on gas connections [58:6.16, 58:6.17] G8d

FUEL & POWER SOURCES CHECKLIST

- Verify that fuel tanks are filled to the capacity needed for uninterrupted operation during normal operating hours. [1:10.14.10.1 for carnivals only] F1a
- Ensure that refueling is conducted only during non-operating hours. [96:8.18.3] F1b
- Check that any engine-driven source of power is separated from the public by barriers, such as physical guards, fencing, or enclosures. [96:8.16.2.2] F2
- Ensure that any engine-driven source of power is shut down prior to refueling from a portable container. [1:11.7.2.1.2] F3
- Check that surfaces of engine-driven source of power are cool to the touch prior to refueling from a portable container. F3a
- Make sure that exhaust from engine-driven source of power complies with the following: F4
 - At least 10 ft in all directions from openings and air intakes [96:8.13] F4a
 - At least 10 ft from every means of egress [96:8.13] F4b
 - Directed away from all buildings [1:11.7.2.2] F4c
 - Directed away from all other cooking vehicles and operations [1:11.7.2.2] F4d
- Ensure that all electrical appliances, fixtures, equipment, and wiring complies with the NFPA 70®. [96:8.18] F5

PROPANE SYSTEM INTEGRITY CHECKLIST

- Check that the main shutoff valve on all gas containers is readily accessible. [58:6.26.4.1(3)] P1
- Ensure that portable gas containers are in the upright position and secured to prevent tipping over. [58:6.26.3.4] P2
- Inspect gas systems prior to each use. [96:8.19.2.3] P3
- Perform leak testing on all new gas connections of the gas system. [58:6.16; 58:6.17] P4
- Perform leak testing on all gas connections affected by replacement of an exchangeable container. [58:6.16; 58:6.17] P5
- Document leak testing and make documentation available for review by the authorized official. [58:6.26.5.1(M)] P6
- Ensure that on gas system piping, a flexible connector is installed between the regulator outlet and the fixed piping system. [58:6.26.5.1(B)] P7
- Where a gas detection system is installed, ensure that it has been tested in accordance with the manufacturer's instructions. [96:8.19.2.1] P8

OPERATIONAL SAFETY CHECKLIST

- Do not leave cooking equipment unattended while it is still hot. (This is the leading cause of home structure fires and home fire injuries.) OA
- Operate cooking equipment only when all windows, service hatches, and ventilation sources are fully opened. [96:14.2.2; 96:14.2.3] OB
- Close gas supply piping valves and gas container valves when equipment is not in use. [58:6.26.8.3] OC
- Keep cooking equipment, including the cooking ventilation system, clean by regularly removing grease. [96:11.4] OD

SOLID FUEL SAFETY CHECKLIST (WHERE WOOD, CHARCOAL, OR OTHER SOLID FUEL IS USED)

- Fuel is not stored above any heat-producing appliance or vent. [96:14.9.2.2] SA
- Fuel is not stored closer than 3 ft to any cooking appliance. [96:14.9.2.2] SB
- Fuel is not stored near any combustible flammable liquids, ignition sources, chemicals, and food supplies and packaged goods. [96:14.9.2.7] SC
- Fuel is not stored in the path of the ash removal or near removed ashes. [96:14.9.2.4] SD
- Ash, cinders, and other fire debris should be removed from the firebox at regular intervals and at least once a day. [96:14.9.3.6.1] SE
- Removed ashes, cinders, and other removed fire debris should be placed in a closed, metal container located at least 3 ft from any cooking appliance. [96:14.9.3.8] SF

NFPA RESOURCES

NFPA 1, *Fire Code*, 2015 Edition
NFPA 1 *Fire Code Handbook*, 2015 Edition
NFPA 58, *Liquefied Petroleum Gas Code*, 2017 Edition
LP-Gas Code Handbook, 2017 Edition
NFPA 70®, *National Electrical Code®*, 2017 Edition
National Electrical Code® Handbook, 2017 Edition

NFPA 96, *Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations*, 2017 Edition
NFPA 96: *Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations Handbook*, 2017 Edition

For more of these resources,
become an NFPA member



SELMA FIRE & RESCUE

CITY OF SELMA

1500 Broad Street | P.O. Box 450 | Selma, Alabama 36702-0450

Richard Byrd, Interim FIRE CHIEF
Walter Dailey, Interim Asst. Fire Chief

(334) 874-2150 Telephone
(334) 874-1737 Fax
firedept@selma-al.gov

Vendors/ Mobile Food Safety Guidelines:

Appropriate Paperwork:

Truck/trailer (VIN, SN or manufacturer ID, license plate)

Propane:

All propane tanks DOT approved (within re-qualification date) not to exceed 200lb total for all tanks. Painting of tanks that obscure manufacturing or qualification information will not be approved.

All tanks must be secure from over turning.

Daily propane system leak check.

If supplied exterior emergency shut off.

Extinguishers:

All units will have at least (1) 3A:40 B-C rated extinguisher

Any unit using a deep fryer electric/gas will in addition to the above extinguisher, have at least (1) 6L type K wet chemical extinguisher.

Fire extinguisher shall bear a current inspection tag validated within the past 12 months Or a receipt of purchase within the last 12 months available for inspection.

Truck/Trailer Ventilation:

Recommended that any unit using an appliance that produces grease laden vapors have a Type 1 hood system installed.

Hood system inspected, cleaned and maintained

Units with deep fryers electric/propane have a commercial grade hood system.

Cooking Appliances:

All cooking appliances must be listed by UL

Electrical:

No exposed wiring or electrical hazards.

Generators:

Be safely mounted not to extend in the public right of way.

10 ft from means of egress.
10 ft. from openings and air intakes.
Directed away from all buildings.

If you have any questions regarding your inspection you may contact me by e-mail at: inv_pettway@selma-al.gov or by contacting: (334) 431-2831 or (334)876-1172 Monday through Friday between the hours of 8:00a.m. to 4:00 p.m.

Aeneas Pettway Asst. Fire Marshal